
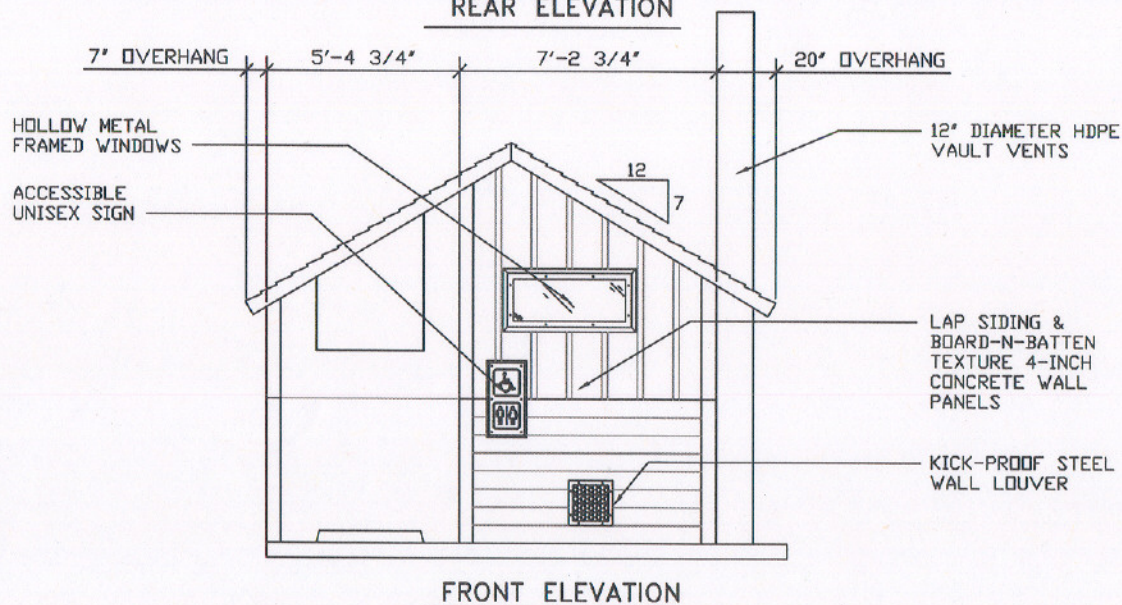
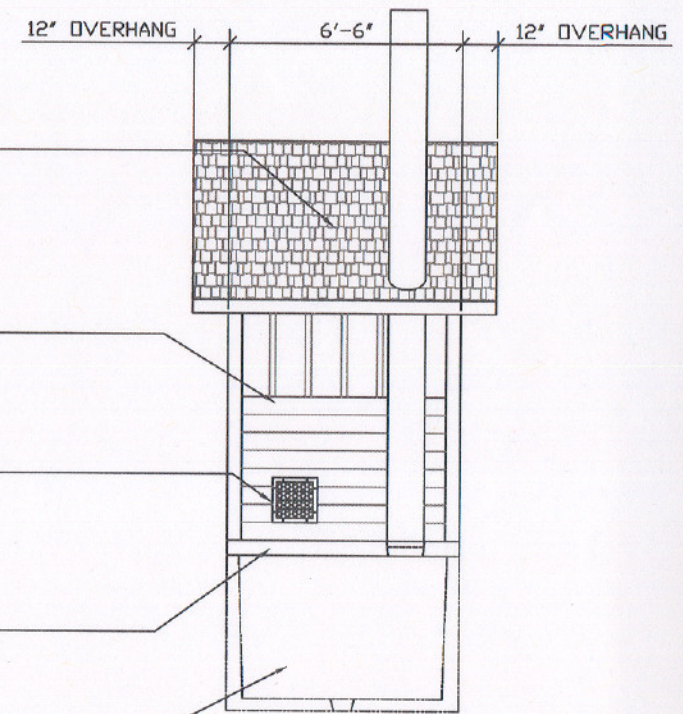


FLOOR PLAN

3/8" = 1'-0"

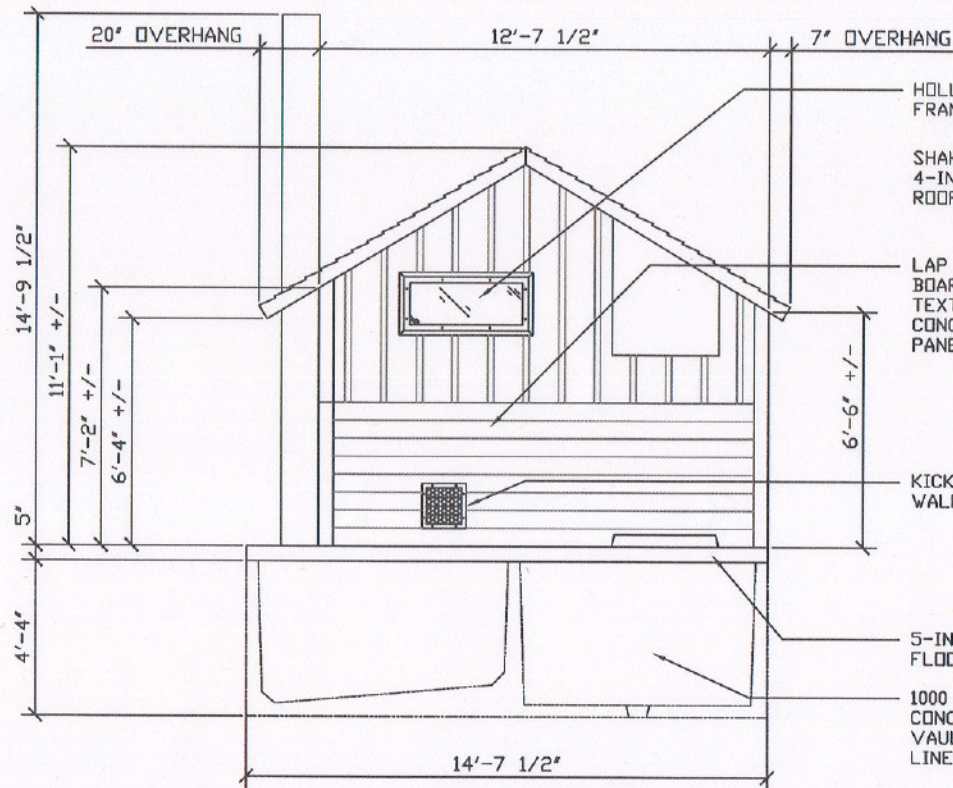

DESIGN FEATURES REQUIRED FOR APPROVAL

ABS LINER CUSTOM FABRICATED TO FIT INSIDE MINIMUM 1000 GALLON SEWAGE VAULT

12 INCH DIAMETER HDPE BLACK VAULT VENT PIPE FOR EACH VAULT

GABLE ROOF DESIGN WITH DRIP EDGE AT SIDE ELEVATIONS TO PREVENT RUSTING OF DOORS AND PROTECTION OF USERS

7/12 MINIMUM ROOF SLOPE

FORMLINER FORMS TO PROVIDE A 'LAP SIDING & BOARD-N-BATTEN' WALL TEXTURE

FORMLINER FORMS TO PROVIDE A 'SHAKE' ROOF TEXTURE

BUILDING DESIGN MUST MEET MINIMUM REQUIREMENTS FOR ACCESSIBLE TOILET ROOMS AS REQUIRED BY THE AMERICAN WITH DISABILITIES ACT ACCESSIBILITY GUIDELINES, LATEST EDITION.